

EX PARTE OR LATE FILED

FLEISCHMAN AND WALSH, L. L. P.

ATTORNEYS AT LAW

A PARTNERSHIP INCLUDING A PROFESSIONAL CORPORATION

AARON I. FLEISCHMAN

FLEISCHMAN AND WALSH, P. C.

CHARLES S. WALSH

ARTHUR H. HARDING

STUART F. FELDSTEIN

RICHARD RUBIN

JEFFREY L. HARDIN

STEPHEN A. BOUCHARD

R. BRUCE BECKNER

HOWARD S. SHAPIRO

CHRISTOPHER G. WOOD

SETH A. DAVIDSON

MITCHELL F. BRECHER

JAMES F. MORIARTY

MATTHEW D. EMMER

JILL KLEPPE MCCLELLAND

REGINA FAMIGLIETTI PACE

TERRI B. NATOLI*

RHETT D. WORKMAN

CRAIG A. GILLEY

MARK F. VILARDO

PETER J. BARRETT

KIMBERLY A. KELLY

ROBERT E. STUP, JR.**

SCOTT H. KESSLER***

RUBY D. CEASER

ANDREW M. FRIEDMAN

LORETTA J. GARCIA

DEBRA A. MCGUIRE

1400 SIXTEENTH STREET, N. W.
WASHINGTON, D. C. 20036

(202) 939-7900

FACSIMILE (202) 745-0916

INTERNET fw@fw-law.com

February 12, 1997

FEB 12 1997

* VIRGINIA BAR ONLY
** PENNSYLVANIA BAR ONLY
*** NEW YORK AND NEW JERSEY BARS ONLY

Mr. William F. Caton, Acting Secretary
Federal Communications Commission
1919 M Street, N.W.
Washington, D.C. 20554

Re: CS Docket No. 95-184 And MM Docket No. 92-260
Notice Of Oral *Ex Parte* Presentation

Dear Mr. Caton:

On February 11, 1994, Dan Brenner of NCTA and the undersigned, representing Time Warner Cable, met with Meredith Jones, Chief of the Cable Services Bureau, and members of her staff regarding positions on the issues raised in the Commission's Notice of Proposed Rulemaking in CS Docket No. 95-184 and the Further Notice of Proposed Rulemaking in MM Docket No. 92-260. The substance of these discussions is contained in the attached talking points paper.

Should you have any questions regarding this presentation, please contact the undersigned.

Respectfully submitted,


Craig A. Gilley
Counsel for Time Warner Cable


cc: Meredith Jones, Esq.
49794

No. of Copies rec'd
List ABCDE

0+1

NUMEROUS PRACTICAL ISSUES NEED TO BE ADDRESSED IF THE POINT OF DEMARCATION IS TO BE MOVED.

- A. Procedures need to be established to guard against signal leakage.
- B. Procedures need to be established to trace the source of signal leakage if multiple providers serve the same MDU.
- C. Procedures need to be established to prevent one provider from denigrating the integrity of the other provider's network, for example, to prevent provision of internet access or telephony.
- D. Procedures need to be established to guard against theft of service.
- E. The only reasonable proposal to address the signal leakage and theft issues surrounding any change in the MDU broadband demarcation point is to require the installation of a neutral demarcation box, so that no MVPD or other unauthorized party will have any justification for tampering with the distribution facilities of another MVPD in the MDU. Procedures need to be established for the installation, management and recovery of costs associated with the neutral demarcation box.
- F. The Commission needs to address how the change in the demarcation point will affect the incentives of cable operators to upgrade their facilities in MDUs, particularly in light of overall policy of the 1996 Telecommunications Act to "accelerate rapidly private sector deployment of advanced telecommunications and information technologies and services," as well as the Commission's specific obligations under Sec. 706 of the 1996 Act.
- G. The Commission needs to consider whether one provider will be able to block the ability of the other provider to upgrade facilities in an MDU.
- H. The Commission needs to address how its rules interplay with State property and contract law which provide for different demarcations, ownership, or termination rights.
- I. The Commission needs to address how its rules interplay with State access to premises laws, under which many such facilities have been installed.
- J. The Commission needs to address the tax and accounting issues surrounding the transfer of ownership of millions of dollars of distribution infrastructure constructed by the cable industry.
- K. The Commission needs to establish a formula to provide just compensation for the facilities taken from the cable operator in connection with any change in the MDU point of demarcation.

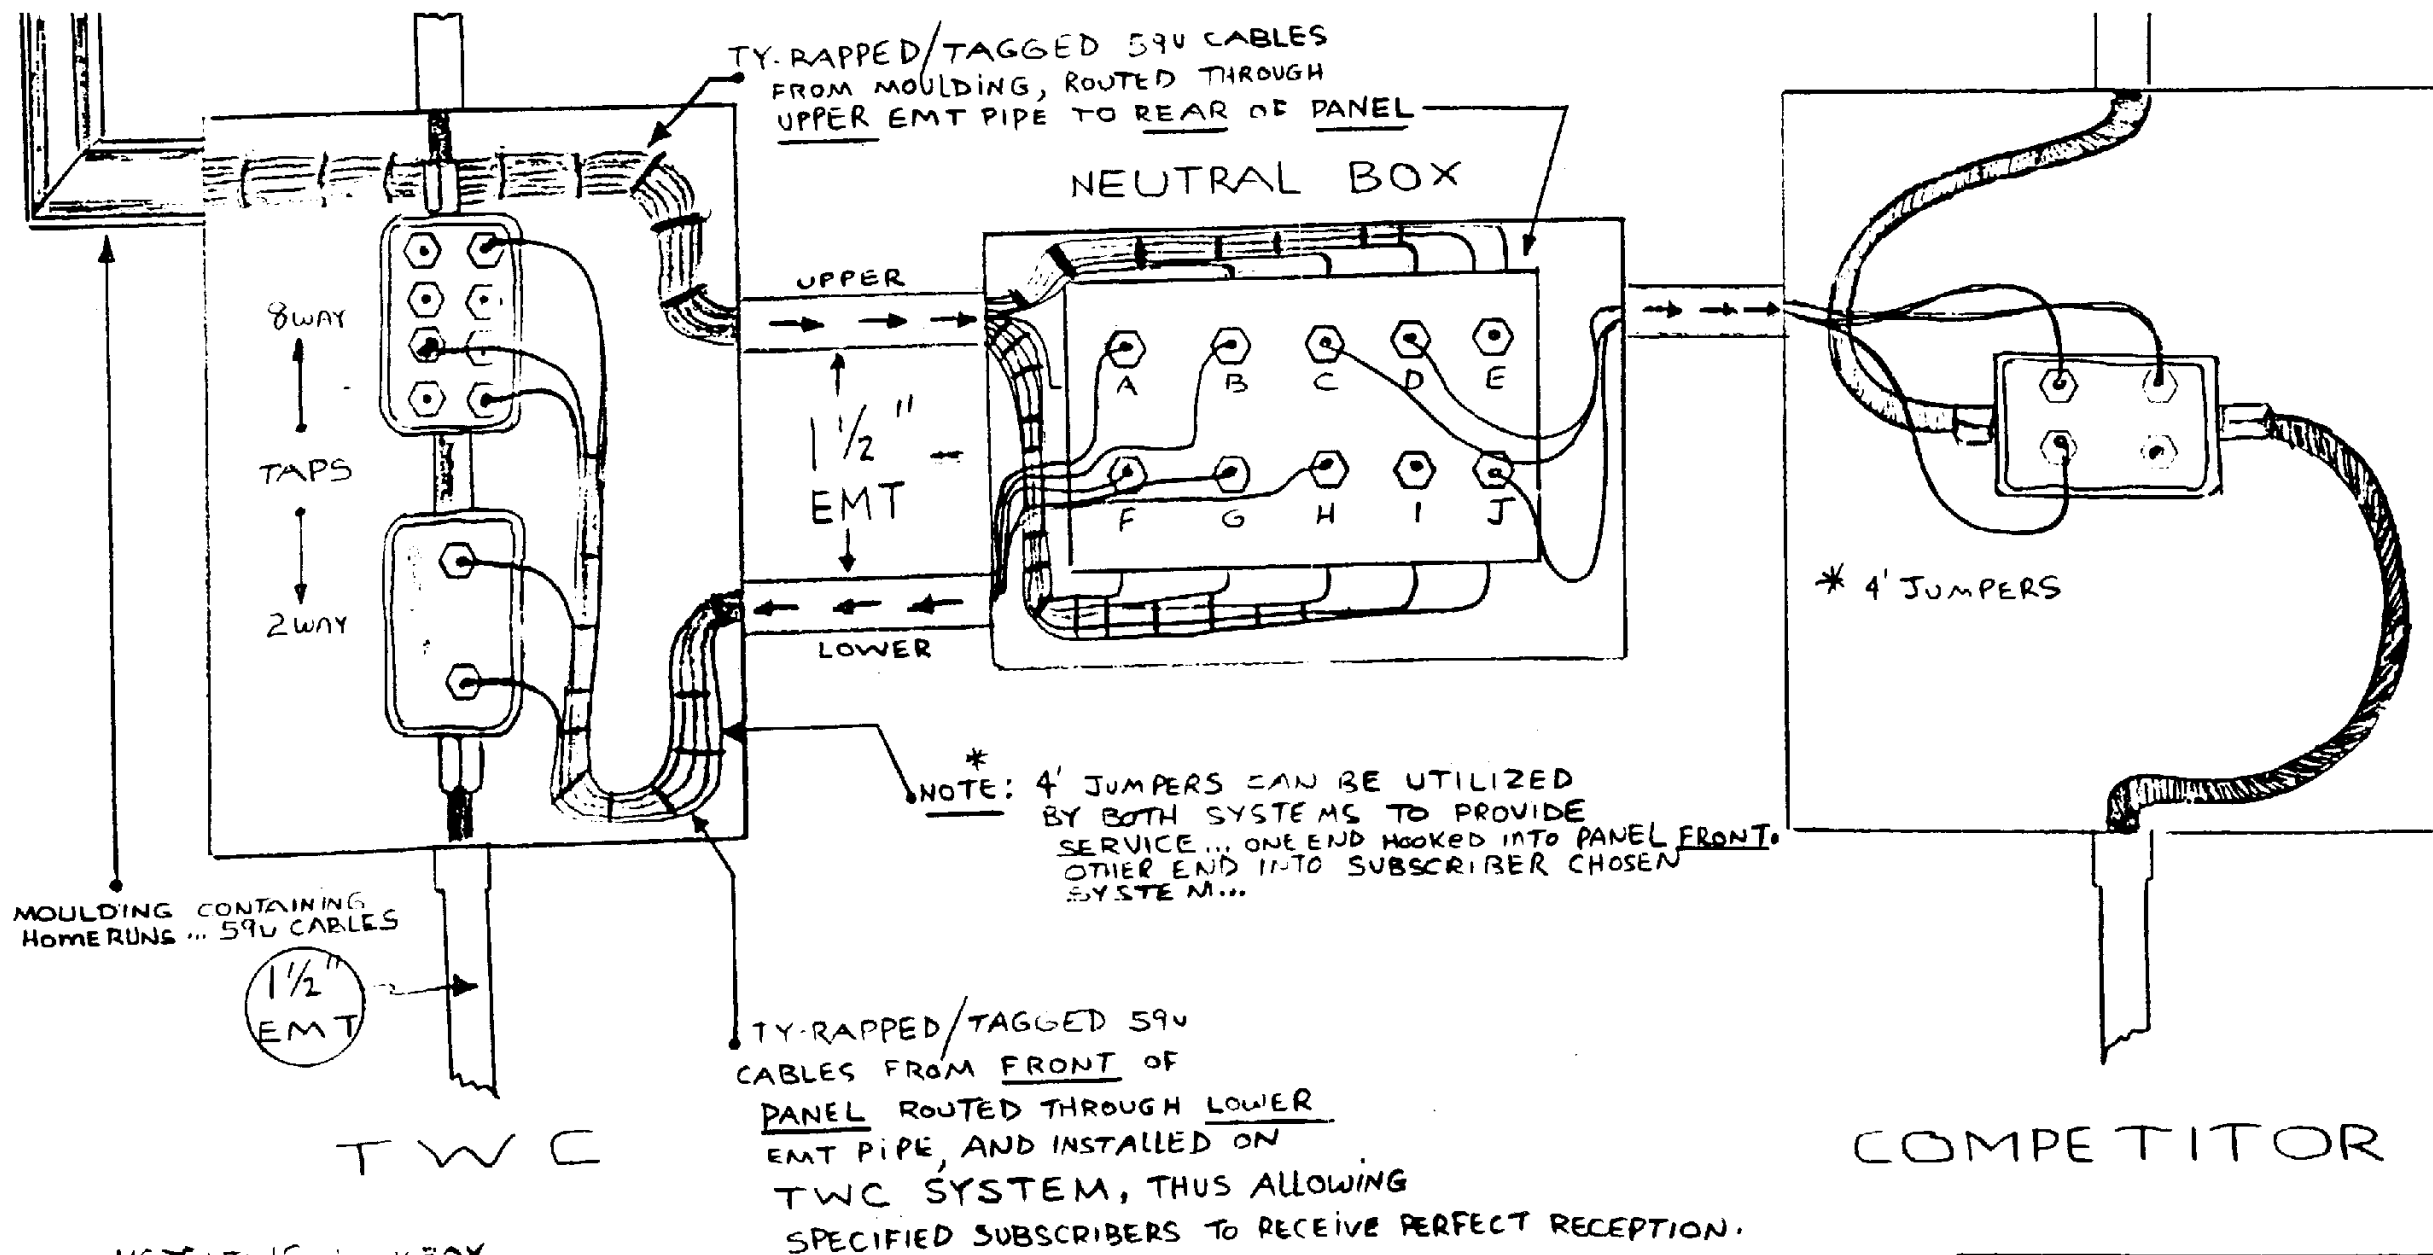

NOTE: TWC & NEUTRAL BOX SHOWN WITHOUT COVER ...

SYSTEM DESIGN SYMBOLS			
412" CABLE	TRUNK BRIDGING	LINE EXTENDER	2 WAY SPLITTER
500" CABLE	2 WAY TRUNK BRDG ALC.	2 WAY LINE EXTENDER	3 WAY SPLITTER
750" CABLE	2 WAY TRUNK	POWER SUPPLY & COUPLER	DIRECTIONAL COUPLER
1000" CABLE	2 WAY TRUNK BRDG W/ALC	IN LINE EQUALIZER	TAP 2 WAY
		TERMINATION	TAP 4 WAY
			TAP 8 WAY



PROJECT NO	BLOCK	LOT
TITLE	DETAIL OF 59US TO AND FROM NEUTRAL BOX PANEL	
DATE	SCALE	DRAWN BY
		DWG NO 4